



DO NOT SCALE DRAWING

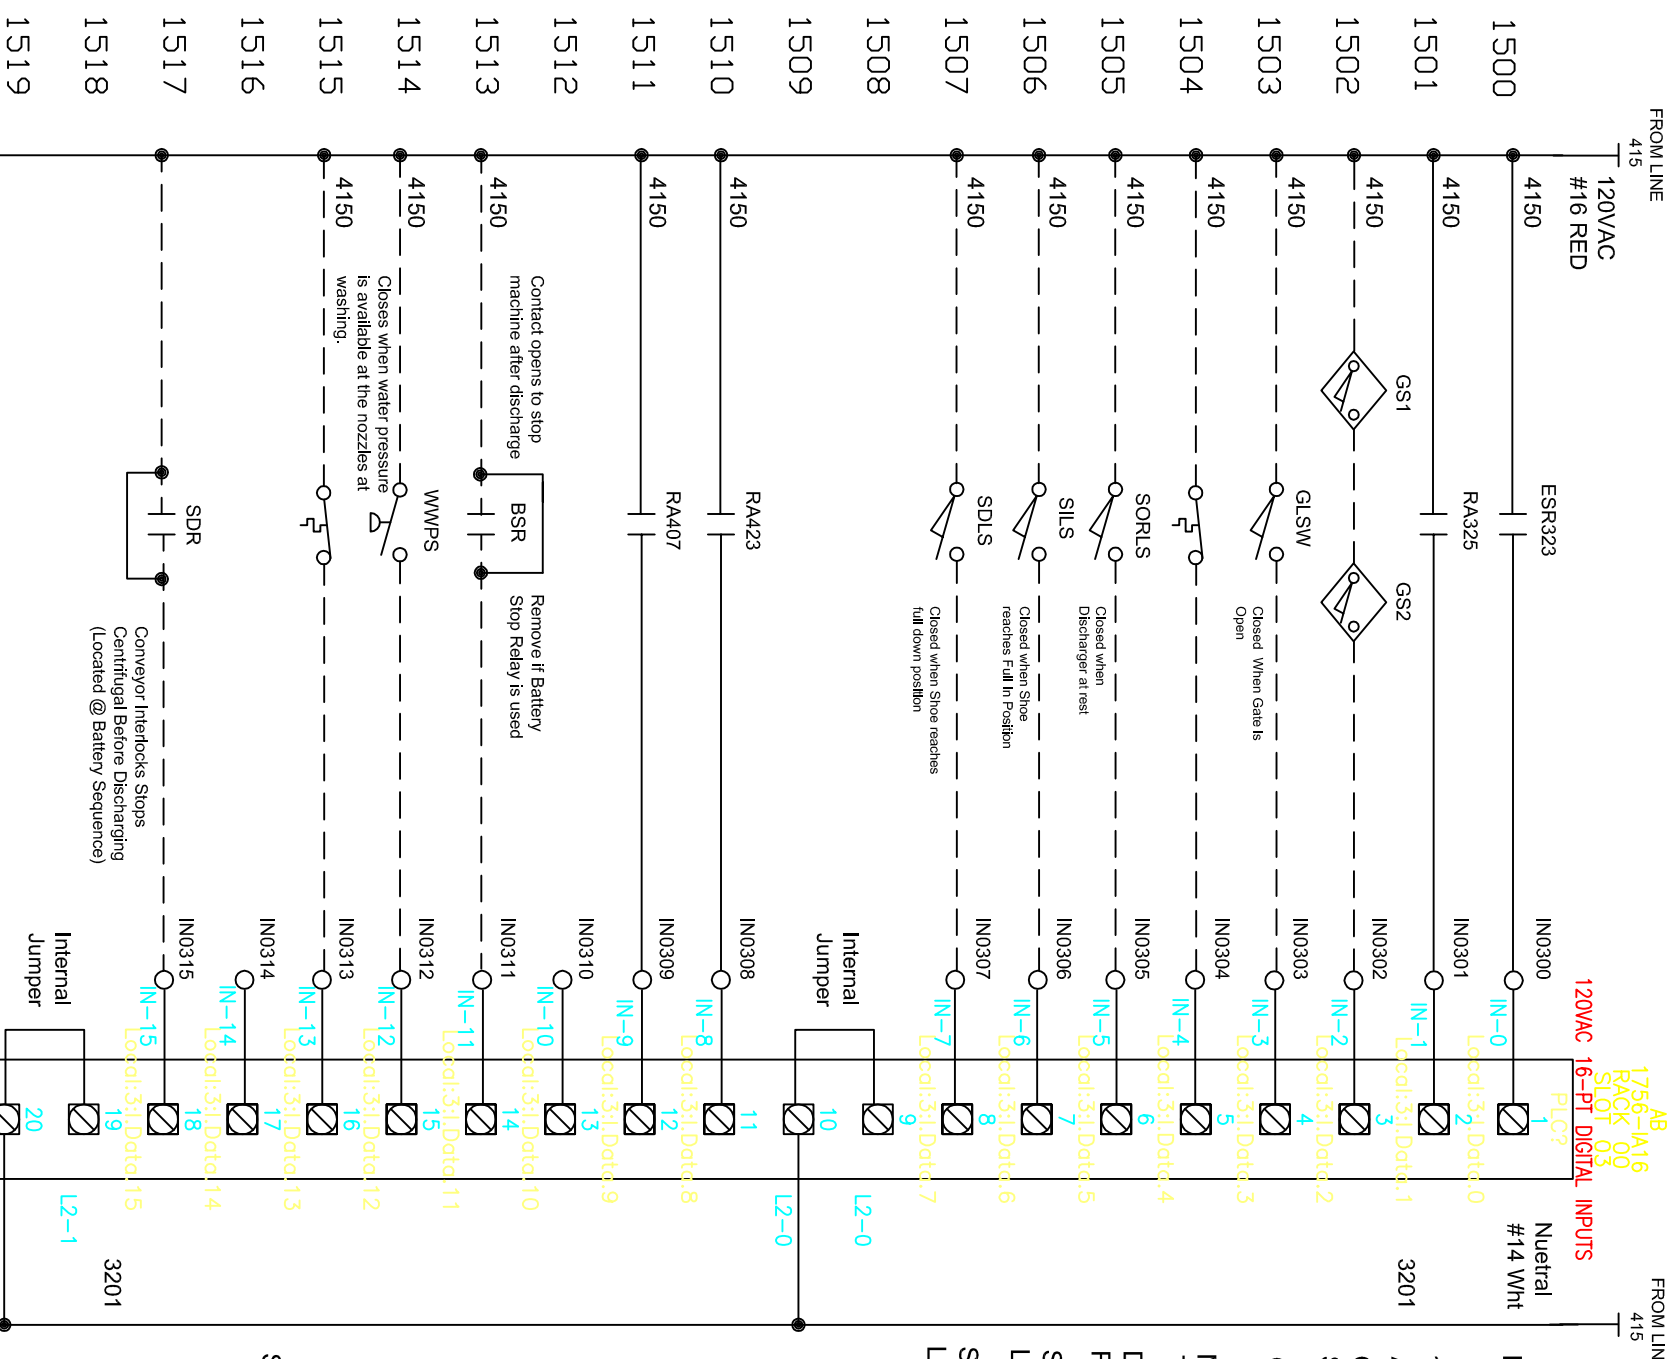

- 1500 E-Stop
- 1501 Aux
- 1502 120VAC
- 1503 Gyration Switch
- 1504 Gate SW
- 1505 Master Resistor Temp Fault
- 1506 Discharger @ Rest Switch
- 1507 Shoe In Limit Switch
- 1508 Shoe Down Limit Switch
- 1509 Main 24VDC Power
- 1510 DeviceNet Power
- 1511 Spare
- 1512 Battery Stop Relay
- 1513 Water Pressure @ Nozzle
- 1514 Slave Resistor Temp Fault
- 1515 Spare
- 1516 Stop Discharge Relay
- 1517
- 1518
- 1519

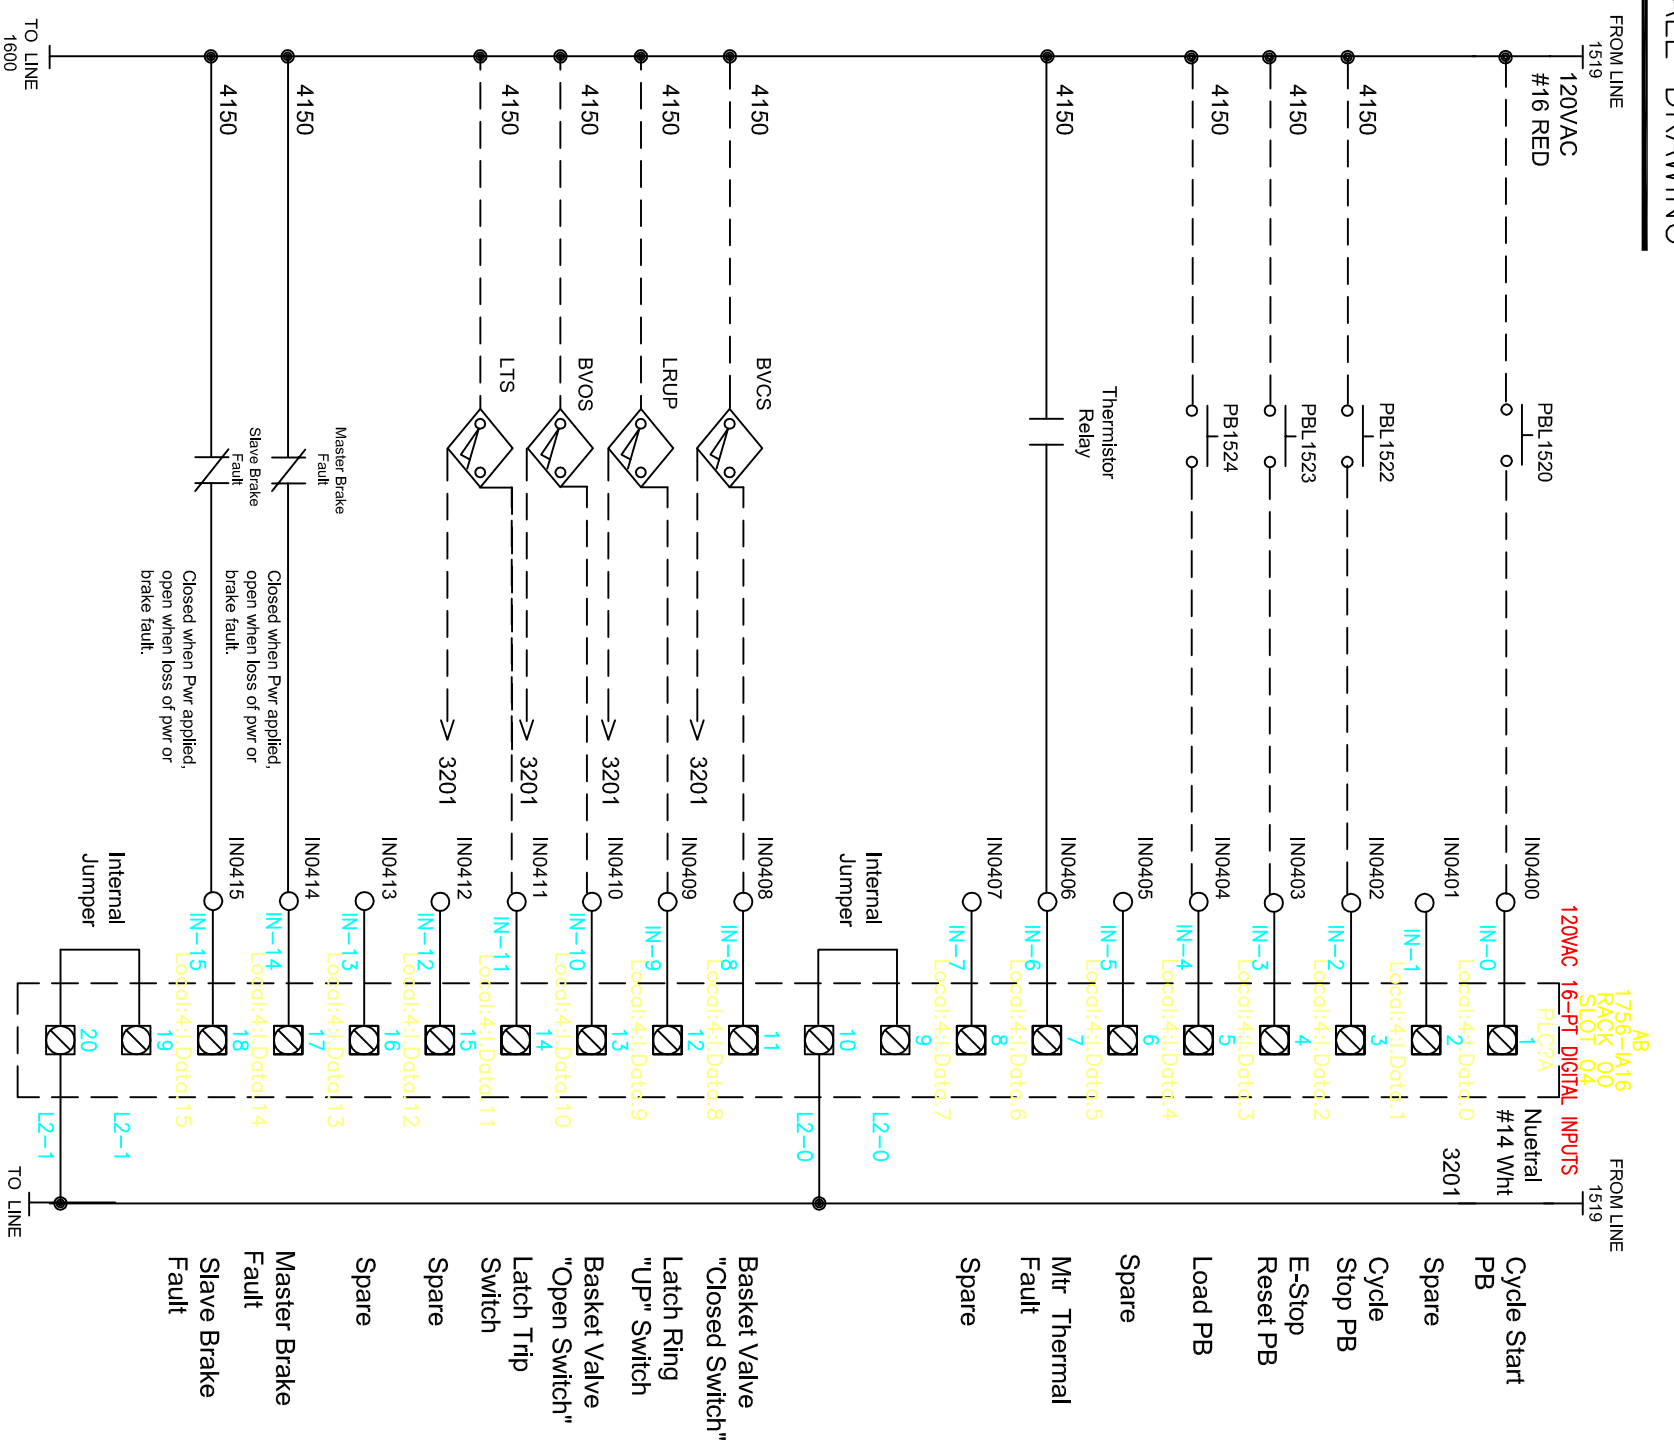

- 1520 Cycle Start PB
- 1521 Cycle Stop PB
- 1522 E-Stop Reset PB
- 1523 Load PB
- 1524 Spare
- 1525 Mtr Thermal Fault
- 1526 Spare
- 1527 Basket Valve "Closed Switch"
- 1528 Latch Ring "UP" Switch
- 1529 Basket Valve "Open Switch"
- 1530 Latch Trip Switch
- 1531 Spare
- 1532 Spare
- 1533 Master Brake Fault
- 1534 Slave Brake Fault
- 1535 Spare
- 1536
- 1537
- 1538
- 1539

Note: Jumper From Term. 10 to 20 for Neutral to Card.

THIRD ANGLE PRODUCTION		MATERIAL		SIGNATURES		DATE		Automated Design & Control, LLC. Lehigh Acres, Florida 33971	
DRAWN		ALL DIMENSIONS ARE GIVEN IN INCHES		C. R. M.		09/08		Centrifugal #4 Input Cards Slots 3 & 4	
CHECKED		TOLERANCES UNLESS OTHERWISE SPECIFIED		C. R. M.		10/08			
APPLICATIION		MISPRINT DIMS AND TOL. PER ASME Y14.5-1994		APPROVED					
		NEXT ASSY USED DN		SIZE SCALE		DWG. NO.		REV	
		APPICATION		N/A		GCSC030408-15		A	
				PROJ. NO.		SHEET		15 OF 22	

CONFIDENTIALITY NOTICE: Golden Grove Sign. This sheet contains information that is the property of Golden Grove Sign. Any person copying this sheet, or its contents, without the written permission of Golden Grove Sign, is prohibited. This notice is printed on all copies, upon request, G2008 through date of last revision listed on this sheet. Golden Grove Sign